
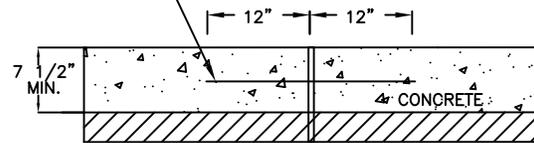


SEE 202 FOR STANDARD CURB AND GUTTER DETAIL

1/2" ϕ REINFORCING BARS (typ) SEE NOTE 3

1/4" EXPANSION JOINTS (typ)

(3) 1/2" ϕ X 24" SMOOTH DOWELS @ 15" O.C. (typ) SEE NOTE 3

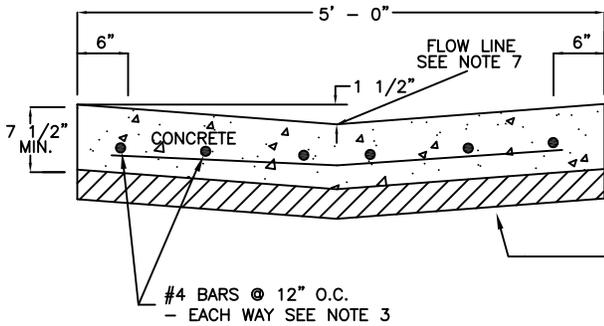

SEE NOTE 4

#4 BARS @ 12" O.C. - EACH WAY SEE NOTE 3

SECTION A-A

SECTION B-B

NOTES:

- 1.) ALL WORK TO BE DONE, AND ALL MATERIALS SUPPLIED, SHALL CONFORM TO THE STANDARD SPECIFICATIONS, STATE OF CALIFORNIA, DEPARTMENT OF TRANSPORTATION, DATED JULY 2002.
- 2.) ALL CONCRETE SHALL BE CLASS 3.
- 3.) STEEL REINFORCEMENT SHALL CONFORM TO SECTION 52, "REINFORCEMENT", OF THE STANDARD SPECIFICATION.
- 4.) PROVIDE 6" MIN. CLASS 2 AGGREGATE BASE AT 95% RELATIVE COMPACTION OVER NATIVE SOIL PROCESSED AND COMPACTED TO 95% RELATIVE DENSITY.
- 5.) BROOM FINISH SHALL BE PARALLEL TO THE DIRECTION OF FLOW.
- 6.) FLOW LINE ELEVATIONS MUST BE APPROVED BY CITY ENGINEER.

VALLEY GUTTER

DATE	REVISIONS	BY

CITY OF BIGGS	
STANDARD DETAIL	
208	
DAVID L. SWARTZ, P.E. APPROVED	1/97 DATE