
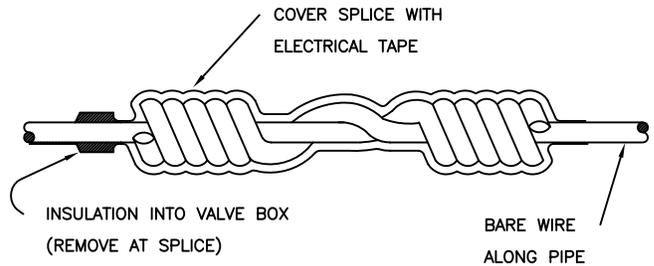


TYPICAL LAYOUT

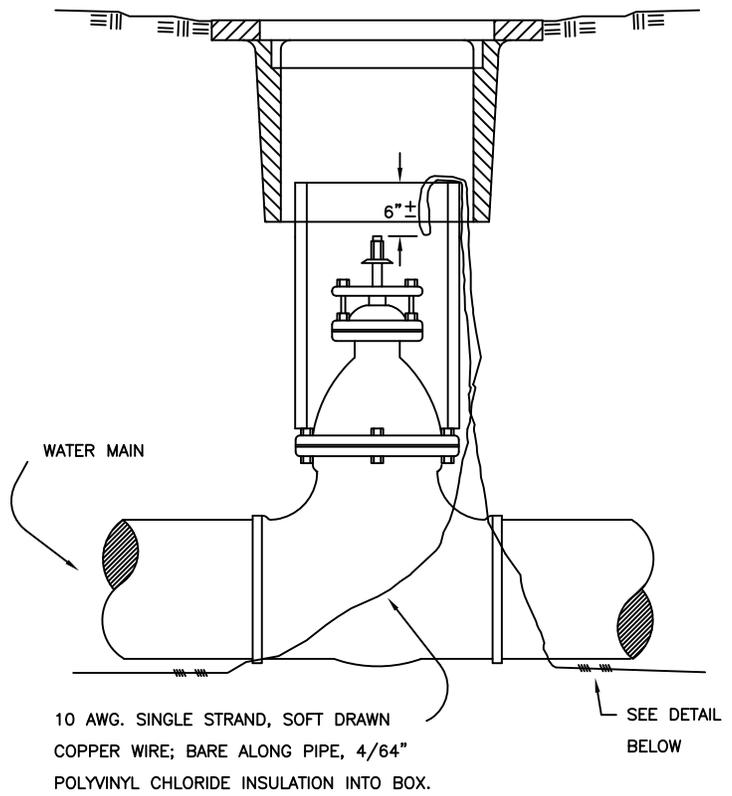

SPLICE DETAIL

NOTES:

1. WIRE TO BE CONTINUOUS BETWEEN VALVE BOXES, EXCEPT AS NOTED.
2. BARE WIRE NOT TO TOUCH VALVES OR FITTINGS.
3. LOCATING WIRE TO BE LAID AT BOTTOM OF TRENCH, NEXT TO PIPE.
4. LOCATING WIRE MUST BE TESTED & BE IN WORKING ORDER AFTER ALL UNDERGROUND WORK IS DONE, AND PRIOR TO STREET PAVING.

LOCATING WIRE FOR WATER MAINS AND SERVICES

| | | |
|------|-----------|----|
| | | |
| | | |
| | | |
| | | |
| DATE | REVISIONS | BY |

| | |
|----------------------------------|--------------|
| CITY OF BIGGS | |
| STANDARD DETAIL | |
| 306 | |
| DAVID L. SWARTZ P.E. APPROVED | 1/97 DATE |