


PROFILE

FULL BODY SUPPORT SADDLE (FORD FS 202 OR EQUAL) ON PVC C900 WATER MAIN. USE STANDARD DOUBLE STRAP SADDLE ON OTHER PIPE MATERIALS. SADDLE TO BE ONE SIZE LARGER THAN SERVICE FOR NYLON BUSHING WITH OTHER THAN BRONZE SADDLE.

BALL-TYPE COMPRESSION CORPORATION STOP (JAMES JONES J-1935SG OR EQUAL) INSTALLED IN A NYLON BUSHING.

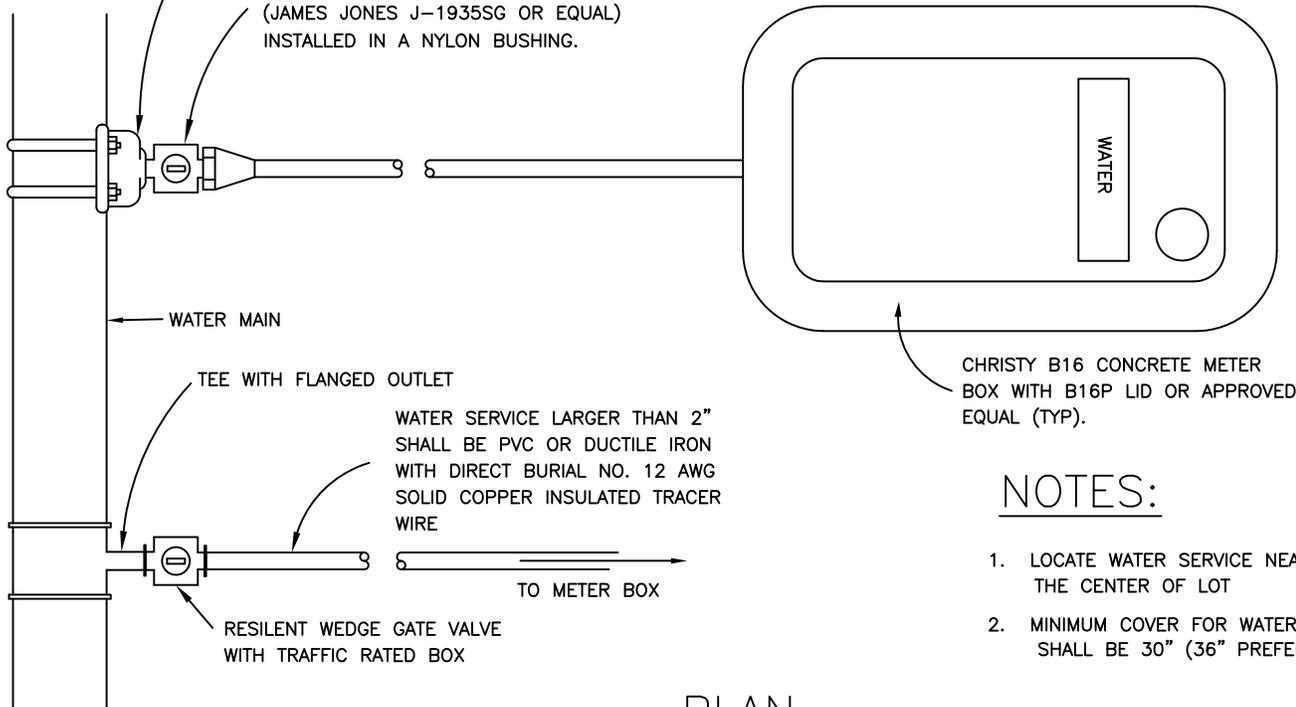

NOTES:

1. LOCATE WATER SERVICE NEAR THE CENTER OF LOT
2. MINIMUM COVER FOR WATER MAIN SHALL BE 30" (36" PREFERRED)

PLAN

SINGLE WATER SERVICE MAIN CONNECTION

6-94	LID TYPE	S.M.M.
08/02/05	NEW WATER METER	P.W.P.
DATE	REVISIONS	BY

CITY OF BIGGS
STANDARD DETAIL
307A
DAVID L. SWARTZ, P.E. APPROVED
1/97 DATE