


D AND L SUPPLY 9 1/2"
TRAFFIC VALVE BOX TYPE
K-6016 OR APPROVED
EQUAL MARKED "WATER"

COVER DETAIL

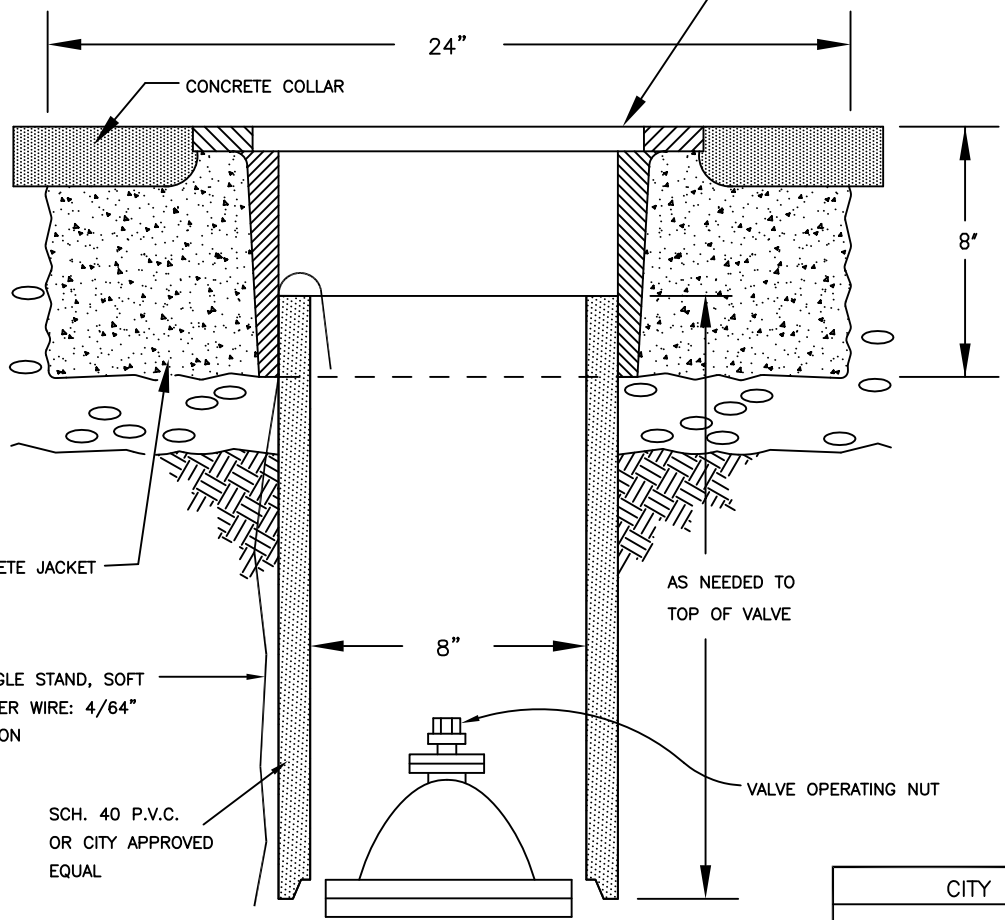

CLASS 3 CONCRETE JACKET

10 AWG. SINGLE STAND, SOFT
DRAWN COPPER WIRE: 4/64"
PVC INSULATION

SCH. 40 P.V.C.
OR CITY APPROVED
EQUAL

AS NEEDED TO
TOP OF VALVE

VALVE OPERATING NUT

WATER VALVE BOX

DATE	REVISIONS	BY

CITY OF BIGGS	
STANDARD DETAIL	
305	
DAVID L. SWARTZ, P.E. APPROVED	1/97 DATE